

CMAP Supplier Campaigning

Supplier's Quick Reference Guide

Rev 3

September 18th, 2026

EVERY CONNECTION COUNTS



Overview of CMAP Supplier Campaigning Quick Guide



TE Connectivity is engaging its supply chain to collect information regarding legislation on restricted and reportable substances in products. TE has selected the **Compliance Map (CMAP)** platform to support this initiative. This reference guide provides helpful resources and instructions to assist you in submitting your responses.

This Quick Guide covers how suppliers:

- **Receive campaign notifications**
- **Access CMAP Portal**
- **Complete and submit required surveys and declarations for compliance specs like EU ROHS, EU REACH, PFAS etc.**
- **Complete TE Medical Device Survey (TE custom survey)**
- **Conflict Mineral Reporting Template (CMRT)**
- **Extended Mineral Reporting Template (EMRT)**

Legends & Descriptions



Abbreviation	Definition
CMAP	The Compliance Map
SR	Supplier Response (a high-level compliance declaration submitted by a supplier in the CMAP Portal to confirm whether a part contains or does not contain regulated substances under a specific compliance requirement to confirm the compliance status of a part)
FMD	Full Material Disclosure (a detailed declaration submitted by a supplier that provides the complete material composition of a part, including all materials and substances present, along with their respective quantities).
RoHS	Restriction of Hazardous Substances
REACH	Registration, Evaluation, Authorization and Restriction of Chemicals
CMRT	Conflict Minerals Reporting Template
EMRT	Extended Minerals Reporting Template
PFAS	Per- and Polyfluoroalkyl Substances
Class C	The form type to be selected in the CMAP Portal for submitting Supplier Response (SR)
TE MD	TE Medical Device Survey (TE'S custom campaign)


The Compliance Specs & Campaign Requests

Suppliers will receive campaign requests for the below compliance specs from (suppliercompliancesupport@te.com):

- EU RoHS
- EU REACH SVHC
- EU REACH Annex XVII (Article 67 / Restriction List)
- CA Proposition 65
- PFAS
- TE Low Halogen
- TE Banned & Targeted Substance
- TE Medical Device Questionnaire Survey *(with TE Custom Medical Device Template attached in campaign email)*

Campaign requests for the below will be received from minedminerals@te.com *(with the respective templates attached in campaign email including Build ID in file name)*


- Conflict Mineral Reporting Template (CMRT)
- Extended Mineral Reporting Template (EMRT)

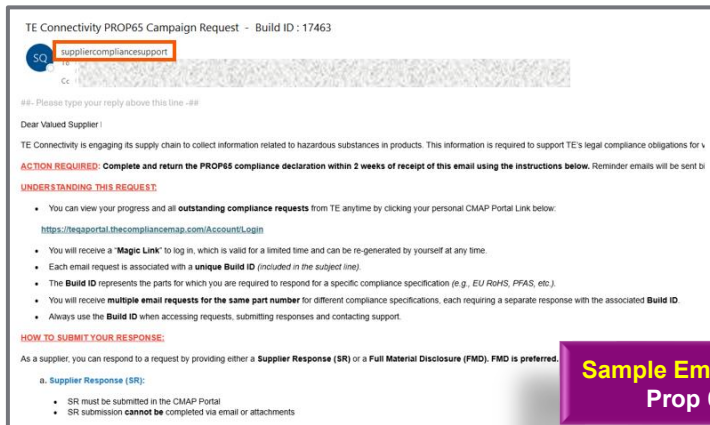

Sample Email – CA Prop 65



Sample Email – TE Medical Device Questionnaire Survey

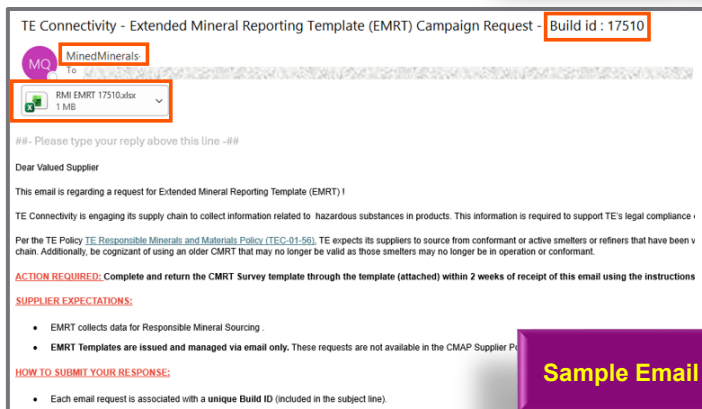

Sample Email – EMRT

Key Concepts: Portal Access & Build ID Management and

Email Notification Access

Access starts with a campaign notification email containing the portal link sent to the registered supplier email address(es).

Magic Link Authentication


Suppliers receive a secure, Magic Link via email to log in without passwords sent to the registered email for time-limited access authentication.

Unique Build ID


Build ID uniquely identifies each compliance campaign, linking part numbers to each compliance specification. This will be indicated in the subject of the email and on the CMAP Portal.

Build Id Generation - Campaign Consolidation


When TE issues a new campaign for the same Compliance Specification, any newly requested parts and outstanding (unanswered) parts from previous Build IDs will be consolidated into a new Build ID. Suppliers should always respond using the latest Build ID, as older Build IDs will be closed. Previously submitted parts will not be requested again, and only one active Build ID will be available at a time.

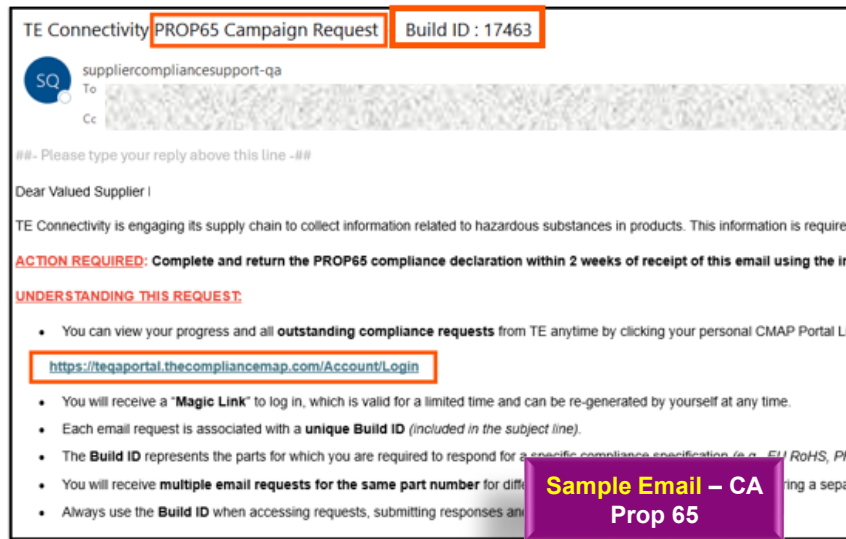


Sample Email – CA Prop 65

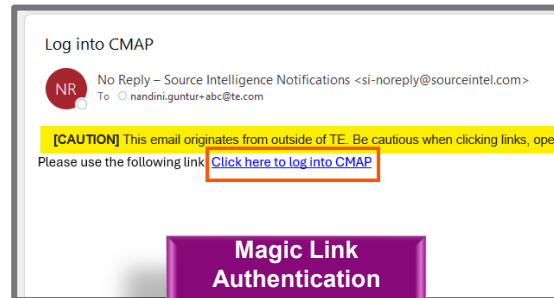

Magic Link Authentication

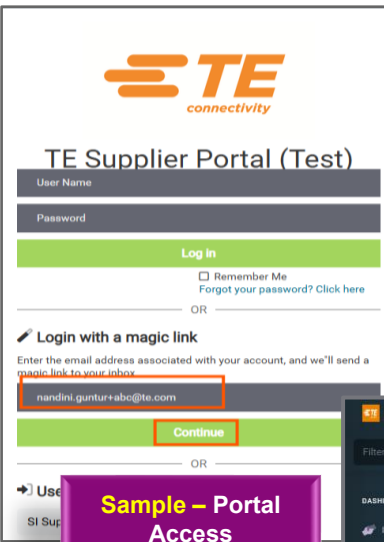


Sample – Portal Access

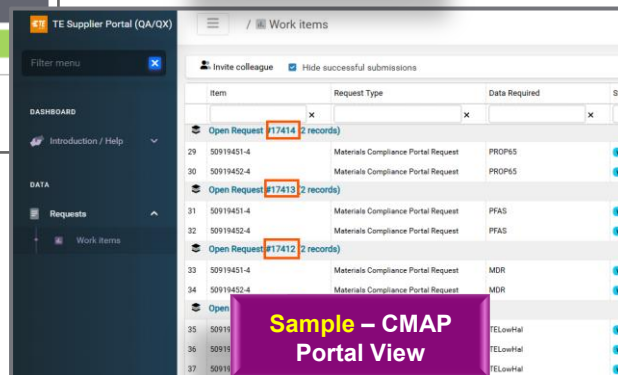

Sample – CMAP Portal View

Key Concepts: Submission, Collaboration & Draft Saving

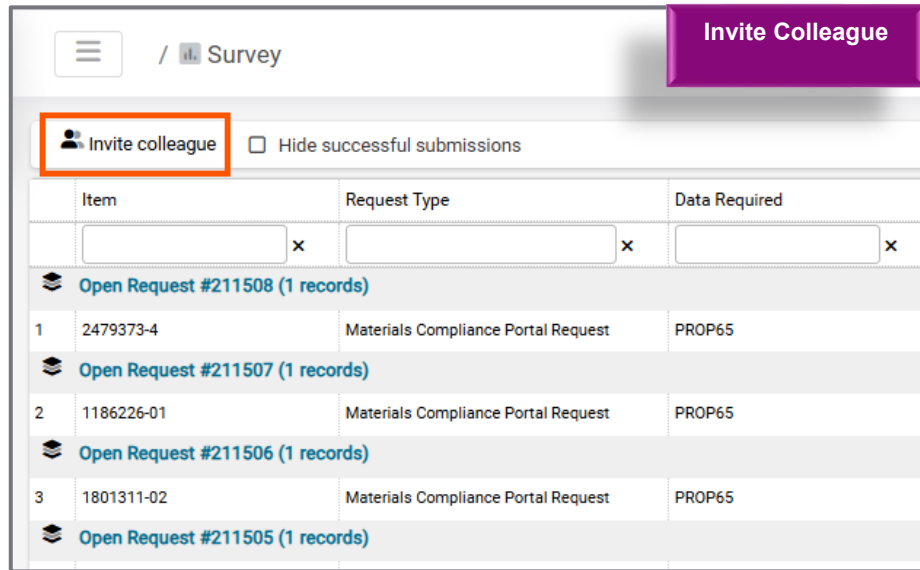

The screenshot shows the 'Survey' interface with a purple 'Invite Colleague' button highlighted. Below the button, there is a table with columns: Item, Request Type, and Data Required. The table contains three rows of data, each with an 'Open Request' link.


Item	Request Type	Data Required
2479373-4	Materials Compliance Portal Request	PROP65
1186226-01	Materials Compliance Portal Request	PROP65
1801311-02	Materials Compliance Portal Request	PROP65

Submission Alignment

Submissions which are to be sent via email (TE Medical Device Survey/ CMRT/EMRT except IPC 1752A) must include Build ID number in the file name and be returned as attachment to the Build ID email.

Collaboration and Data Management

Suppliers can invite colleagues to contribute and manage multiple parts with copy and delete features via '**Invite Colleague**' button.

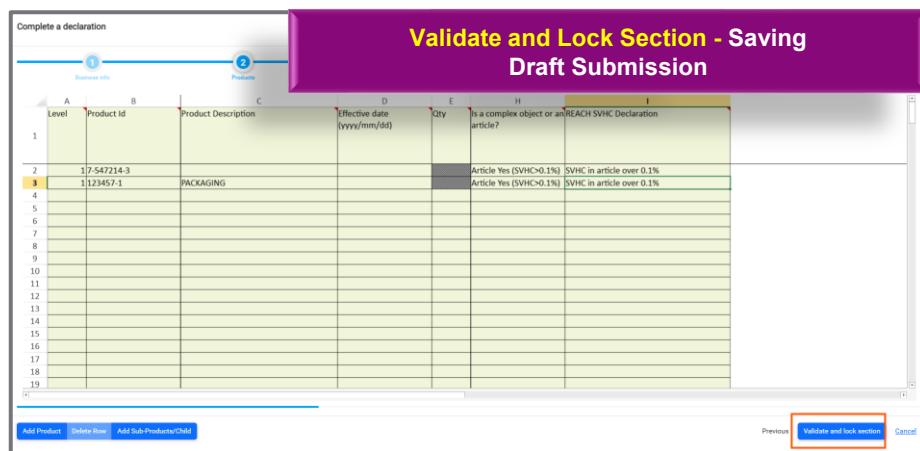

The screenshot shows the 'Complete a declaration' section of the Survey interface. A purple button labeled 'Validate and Lock Section - Saving Draft Submission' is highlighted. Below the button, there is a table with columns: Level, Product Id, Product Description, Effective date (yyyy/mm/dd), Qty, Is a complex object or an article?, and REACH SVHC Declaration. The table contains two rows of data.

Level	Product Id	Product Description	Effective date (yyyy/mm/dd)	Qty	Is a complex object or an article?	REACH SVHC Declaration
1	17-547214-3	PACKAGING			Article Yes (SVHC>0.1%)	SVHC in article over 0.1%
2	1123457-1				Article Yes (SVHC>0.1%)	SVHC in article over 0.1%

Saving A Draft Submission

Use the Validate and Lock Section button to save your responses as a draft on the portal. This allows you to save your progress and return later to complete or update your submission before final submission.

Types of Submissions

Supplier Responses (SR)

SRs are high-level declarations confirming the presence or absence of reportable substances under a specific regulation.

- Use Class C in CMAP Portal to complete **Supplier Responses** for parts
- Mandatory (**Red**) fields must be completed
- **DO NOT** enter data in greyed out fields as these are not applicable to fill
- Selecting the correct compliance status, such as compliant, compliant by exemption and non-compliant, is essential for accuracy.

Full Material Declarations (FMD)

FMDs provide detailed disclosure of all materials including weights and percentages in a part



- Suppliers can send the IPC 1752A XML files for each part number via email.

Responsible Minerals Reporting

CMRT and EMRT templates use standardized templates, completed offline and submitted via email.

Custom TE Medical Device Survey Templates

TE Medical Device Survey use custom templates sent by email instead of the CMAP Portal.

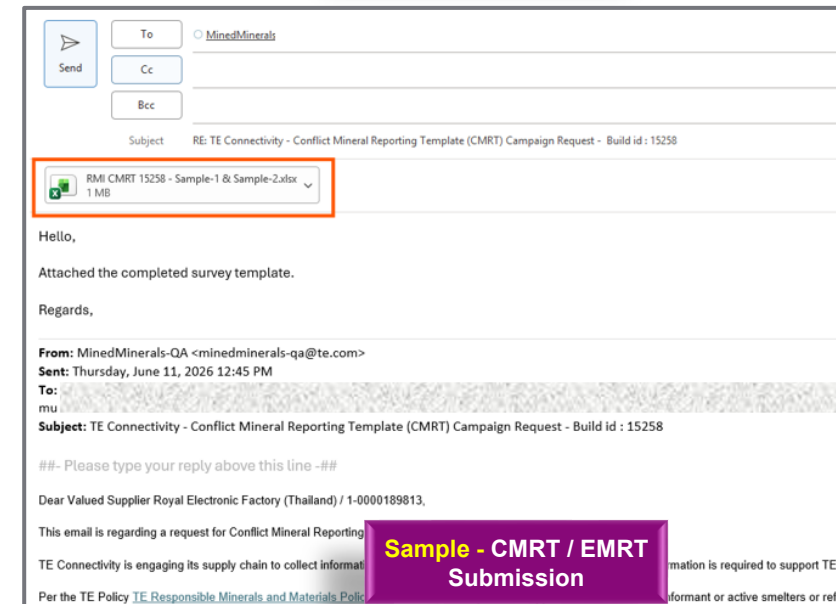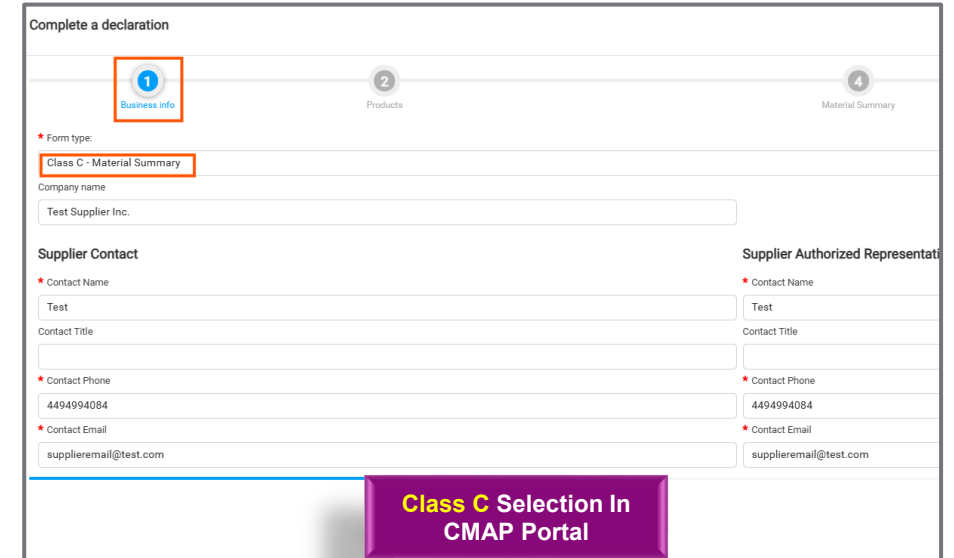

Important Rules and Controls

Complete a declaration

1 Business info 2 Products 3 Material Summary 4 Sign-off form

Level	Product ID	Product Description	Effective date (yyyy/mm/dd)	Qty	EU MDR 10.4.1 Declaration	Latex Declaration	Allergens and Sensitizers Declaration
1	50919463-4	50919463-4					
2	50919463-4	50919463-4					
3							
4							
5							
6							
7							
8							
9							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							

Submission Locked

Complete a declaration

1 Business info 2 Products 3 Material Summary 4 Sign-off form

Level	Product ID	Product Description	Effective date (yyyy/mm/dd)	Qty	EU MDR 10.4.1 Declaration	Latex Declaration	Allergens and Sensitizers Declaration
1							
2	1123456-8	PACKAGING					
3							
4							
5							
6							
7							
8							
9							
10							
11							
12							
13							

Sample – Restricted 'Unknown' Usage for Latex / Allergens & Sensitizers under EU MDR survey

TE QA - TE Connectivity submission error

suppliercompliancesupport-qa

To

Cc

50919463-4.xml
8 KB

Your submission has failed with the following error(s):

- Parts: 50919463-4
File name: 50919463-4.xml
Error: The Part contains TE Banned Substances declared in (Dichlorodimethylsilane)
- Parts: 50919463-4
File name: 50919463-4.xml
Error: Individual single substance weights 100% declared.

Regards,

TE Connectivity

Sample – Error Notification

Submission Locking

Once an SR on a Build ID is submitted, the survey form will be locked and cannot be edited. This is to preserve data integrity.

Methods To Override Previous Submissions For Suppliers

If changes are required after submission, the following alternative options are available:

1. Submit a Full Material Declaration (FMD) in IPC 1752A XML format as attachment via email in response to the campaign notification email as guided in **Section-IV** of the supplier manual.
2. If supplier prefers to submit or override the older submission via a new Supplier Response (SR), send request to TE at suppliercompliancesupport@te.com to create a new campaign providing your old Build ID.

Once the new campaign is created, you can submit a new SR for the same compliance specification.

The new Supplier Response (SR) submission shall override the older submission in TE.

Restricted 'Unknown' Usage

Use of 'Unknown' responses to any compliance specification is limited and only permitted for questionnaire on - **Latex or Allergens and Sensitizers Declaration under EU Medical Device Regulation.**

Notifications on Errors & Warnings

Suppliers may receive automated email notifications for errors or warnings. For example, if a submission has weight mismatches, they will be notified and required to correct and resubmit.

Key Takeaways

❑ Correct Submission Channels

Always respond using specified channels like portal for **SR** and email for **FMD**, **CMRT**, **EMRT** and **TE MD** to ensure accurate communication.

❑ Utilizing Portal Features

Use portal tools like filtering, colleague invitation, and status tracking to manage workload efficiently and timely.

❑ Proactive Support Engagement

Ensure campaign emails are received and contact compliance support at suppliercompliancesupport@te.com proactively to resolve issues quickly.

